




(205) 533-0571
www.pfixcontrols.com

Signal Level Converter

Installation Diagram

Customized Features Available upon Request

Customer supplied and installed AC Power Cable

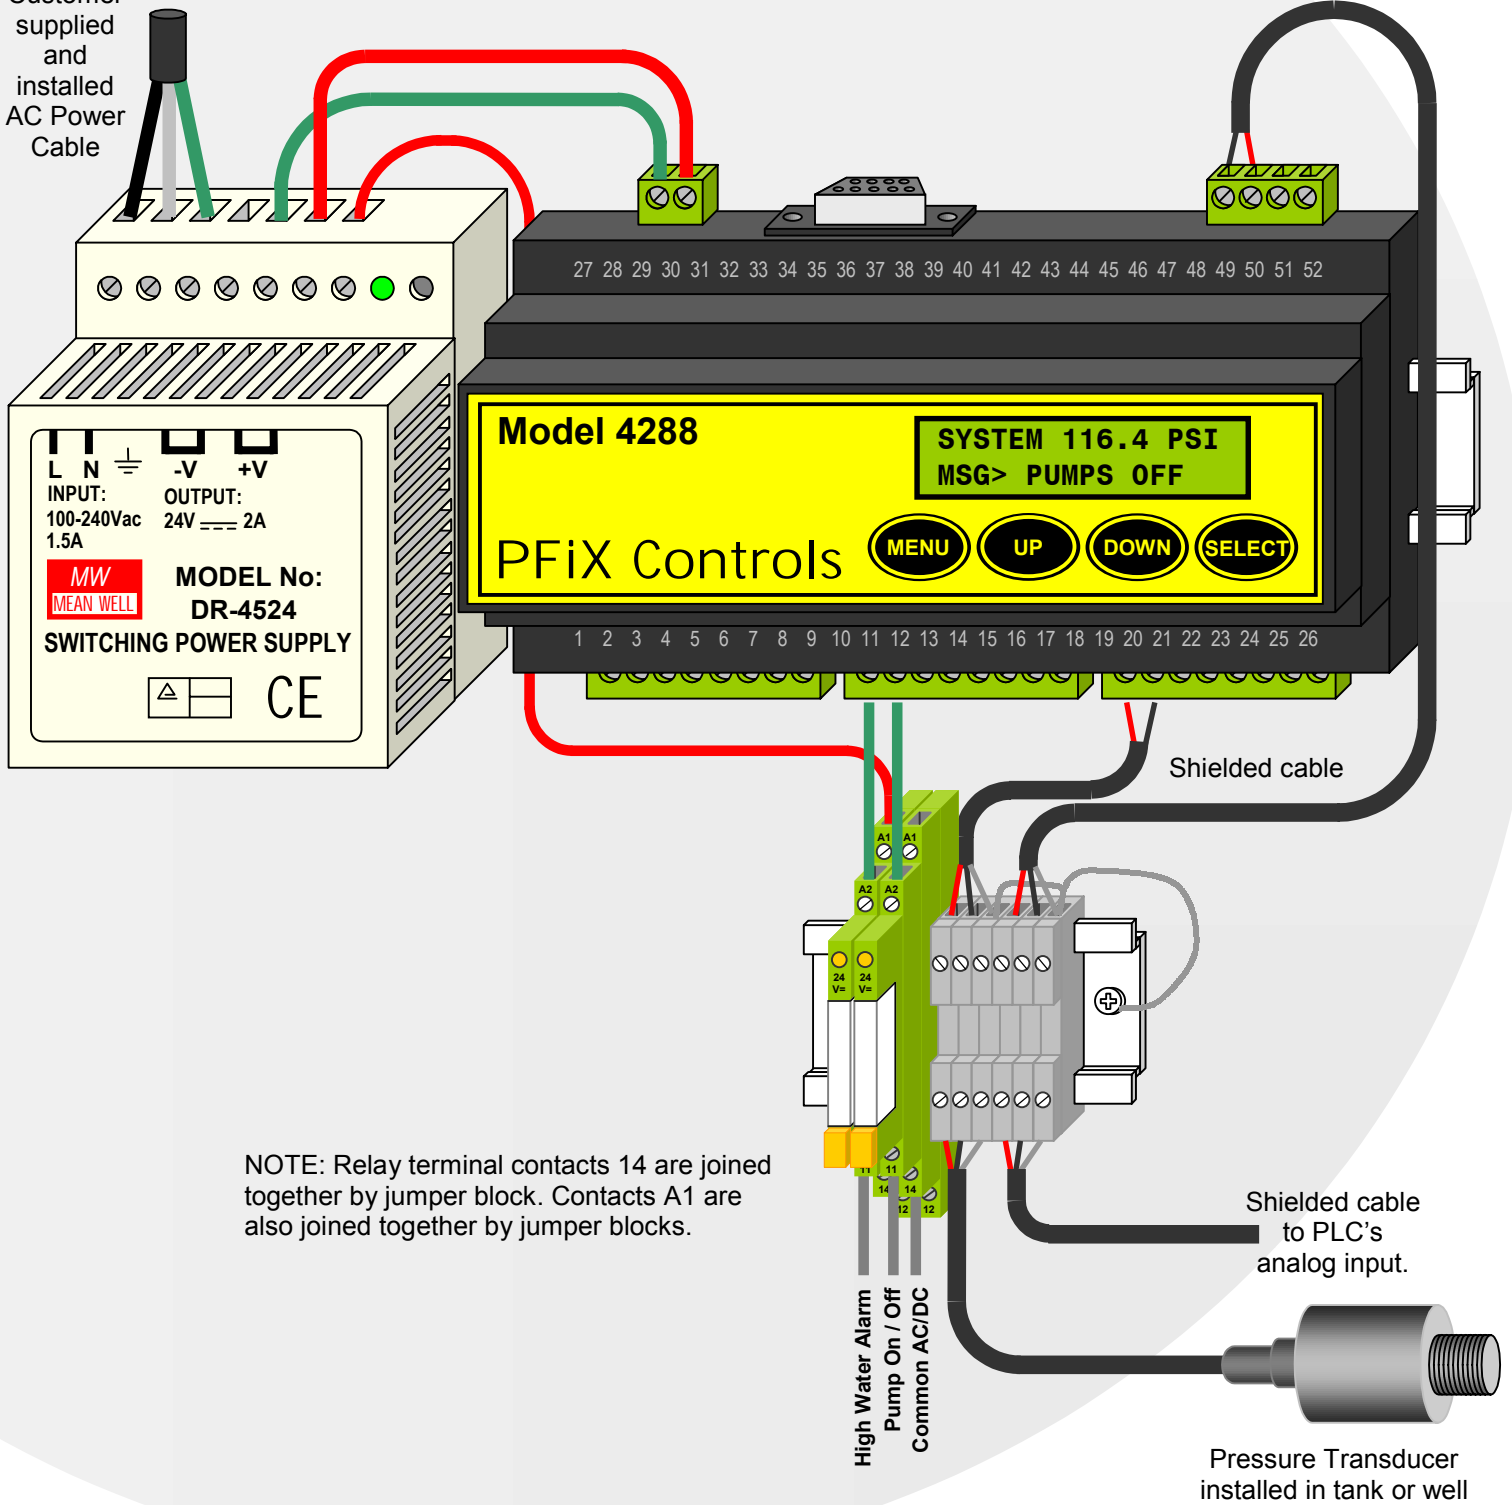

NOTE: Relay terminal contacts 14 are joined together by jumper block. Contacts A1 are also joined together by jumper blocks.

Shielded cable to PLC's analog input.

Pressure Transducer installed in tank or well